

# THE SCOPE AND HOW IT EFFECTS CHAPTER 31

Use this section to answer the following questions:

- ... Where does the 400 sq. ft. limit come from?
- ... Is "open or exposed flame" and / or cooking addressed in the Scope?
- ... Does a tent in excess of 400 sq. ft. have to meet all of the requirements in Chapter 31?

# **SCOPE**

Amendment; LSA Doc. # 13 - 341 (F) 675 IAC 22 - 2.5 (eff. 12 - 01 - 14)

#### **EXCEPT AS OTHERWISE PROVIDED IN**

**SECTIONS 3104.7** 

3104.15.5

3104.15.6

TENTS AND MEMBRANE STRUCTURES HAVING AN AREA IN EXCESS

OF 400 SQUARE FEET SHALL BE IN ACCORDANCE WITH CHAPTER 31.

# **SCOPE**

Amendment; LSA Doc. # 13 - 341 (F) 675 IAC 22 - 2.5 (eff. 12 - 01 - 14)

#### **EXCEPT AS OTHERWISE PROVIDED IN**

SECTIONS 3104.7 OPEN OR EXPOSED FLAME

3104.15.5 **COOKING TENTS** 

3104.15.6 OUTDOOR COOKING


TENTS AND MEMBRANE STRUCTURES HAVING AN AREA IN EXCESS

OF 400 SQUARE FEET SHALL BE IN ACCORDANCE WITH CHAPTER 31.

# **SCOPE**


Amendment; LSA Doc. # 13 - 341 (F) 675 IAC 22 - 2.5 (eff. 12 - 01 - 14)

Except as otherwise provided in Sections 3104.7, 3104.15.5, and 3104.15.6, tents and membrane structures having an area in excess of 400 square feet shall be in accordance with Chapter 31.

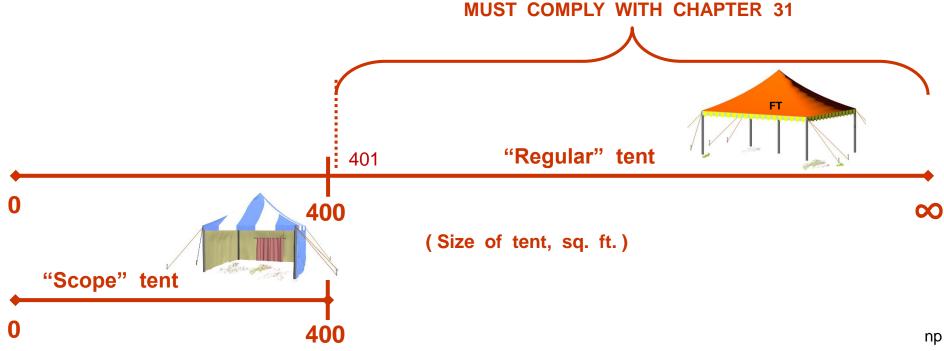

2014 Indiana Fire Code Effective 12-01-2014


Rev Web 7 01-01-2019

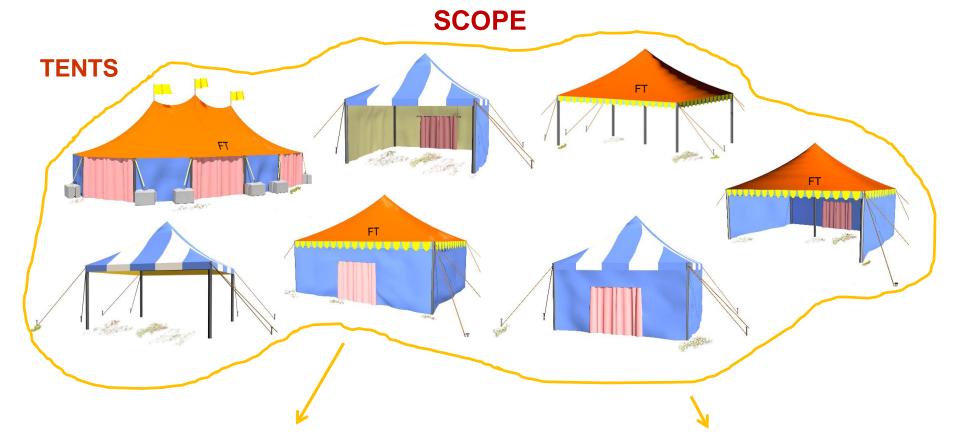

# 400 SQ. FT. OR LESS



IN EXCESS OF 400 SQ. FT.

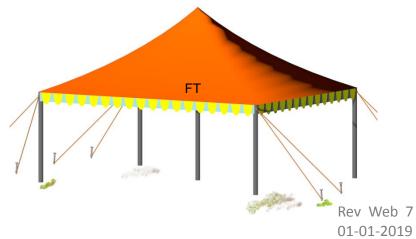

Effective 12-01-2014

Sec. 3101.1



400 SQ. FT. OR LESS



Effective 12-01-2014

THIS GROUP DOESN'T HAVE TO COMPLY WITH ANYTHING IN CH. 31 UNLESS THEY ARE DOING SOMETHING COVERED IN:

SECTIONS ...

3104.7 - OPEN OR EXPOSED FLAME

3104.15.5 - COOKING TENTS

**3104.15.6** - **OUTDOOR COOKING** 

Rev Web 7
Sec. 3101.1

01-01-2019



# 400 SQ. FT. OR LESS



Effective 12-01-2014

WHEN THIS GROUP IS DOING SOME - THING COVERED IN SECTIONS ...


3104.7 - OPEN OR EXPOSED FLAME

3104.15.5 - COOKING TENTS

**3104.15.6** - **OUTDOOR COOKING** 

THEN ONLY THOSE REQUIREMENTS
FOUND IN THOSE 3 SPECIFIC CODE
SECTIONS ARE APPLICABLE
Rev Web 7

**Sec. 3101.1** 01-01-2019

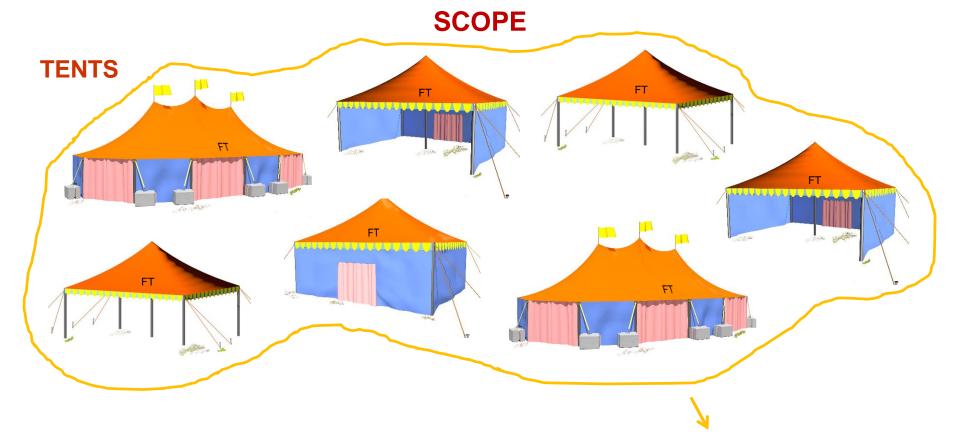


Sec. 3101.1

THIS GROUP HAS TO COMPLY WITH EVERYTHING IN CH. 31

IN EXCESS OF 400 SQ. FT.



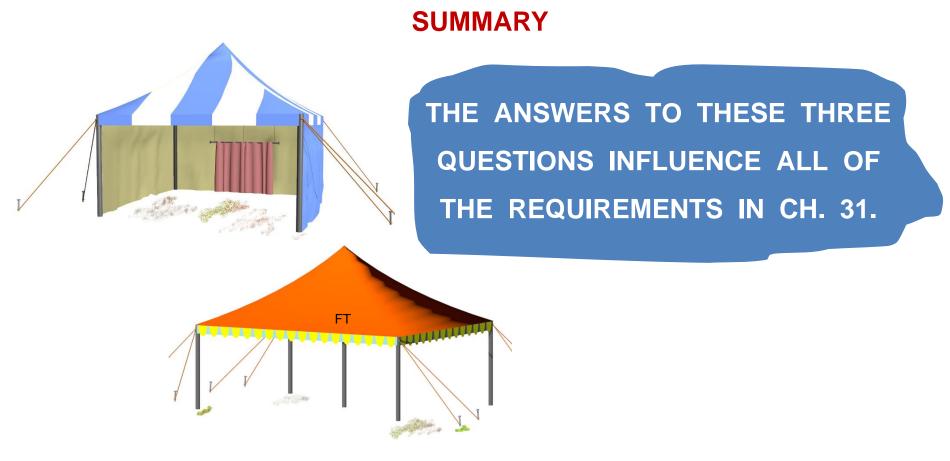

- WHAT IS THE SIZE OF THE TENT?
- DOES THE TENT HAVE ANY SIDEWALLS OR DROPS?
- WHAT IS THE ACTIVITY OCCURRING UNDER THE TENT?



Chapter 31, 2014 Ed.
Indiana Fire Code

# **Tents And Other Membrane Structures**

Presented by the State Fire Marshal's Office

Division of Fire and Building Safety